


# Technical specifications

## Example of standard settings

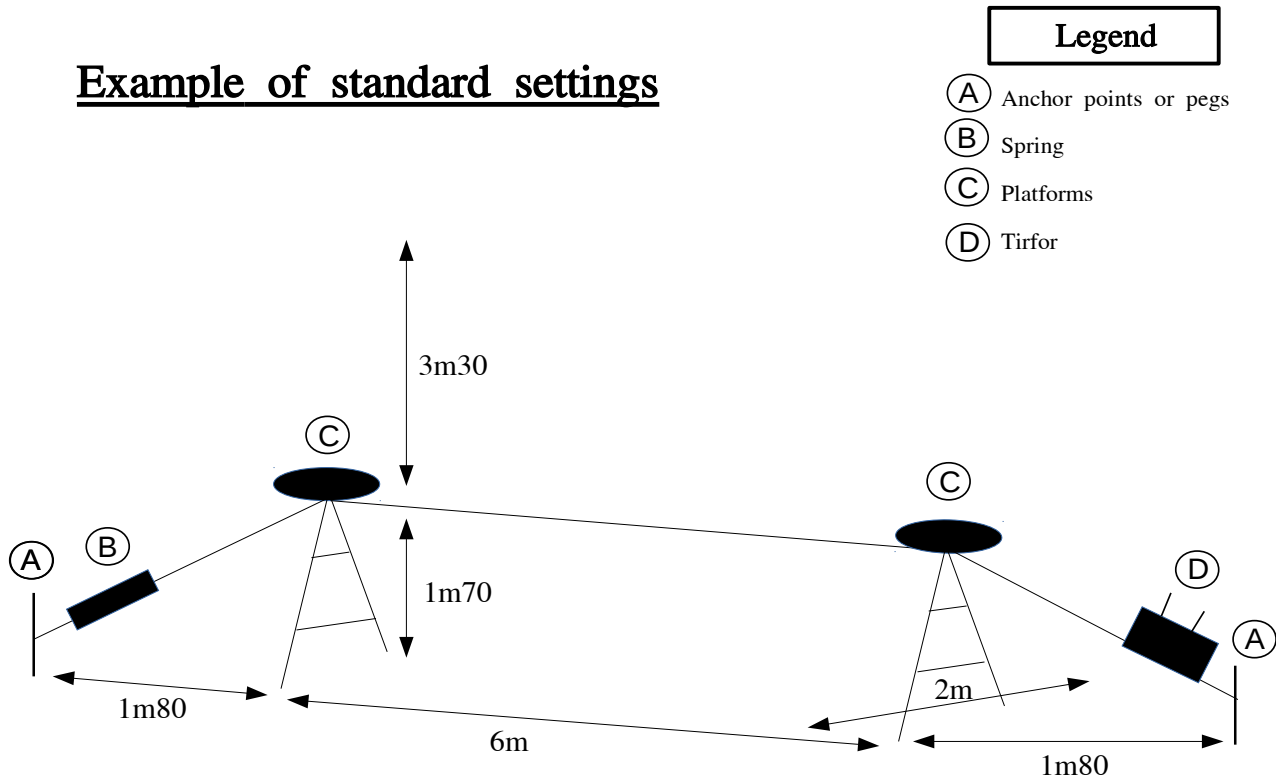

According to space requirement, the act can be performed on a regular wire or on a free-standing wire.

### A tightwire act requires :

- A flat and hard ground
- Appropriate lighting (see the details with the artist)
- A sound system able to play from CD, Ipod (or file previously sent by e-mail)

### For a regular tightwire :

- The presence or the possibility to install two anchor points able to support 2200Kg each
- A minimal distance of 9m20 between these two ground points (walking cable is 6m long)
- A minimal clearance of 2m in width
- A minimal clearance of 5m in height
- If using pegs, someone who helps hammering them down

### For a free-standing wire :

- A minimal length of 7m
- A minimal clearance of 2m in width
- A minimal clearance of 5m on height
- Someone who helps to set up and to strike the wire

**Those specifications provide a general idea. It is possible to adapt the wire and the act to different environments, either inside or outside.**